



Fabrication Specifications				
ITEM	INDEX	DEPTH (mm)	DIA. (mm)	CLOCKFACE POSITION
Tank depth	A	2500	-	-
Tank Ø	B	-	1500	-
Inlet	C1		110	
Inlet	C2			
Inlet	C3			
Discharge	D		63	12
Cable duct	E		110	
Vent	F		110	

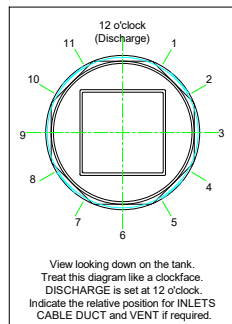

Comments

Please Note - Inlet invert should be between 400 - 1515 mm.

Inlet seals and ducts can be supplied loose to be drilled and fitted on site

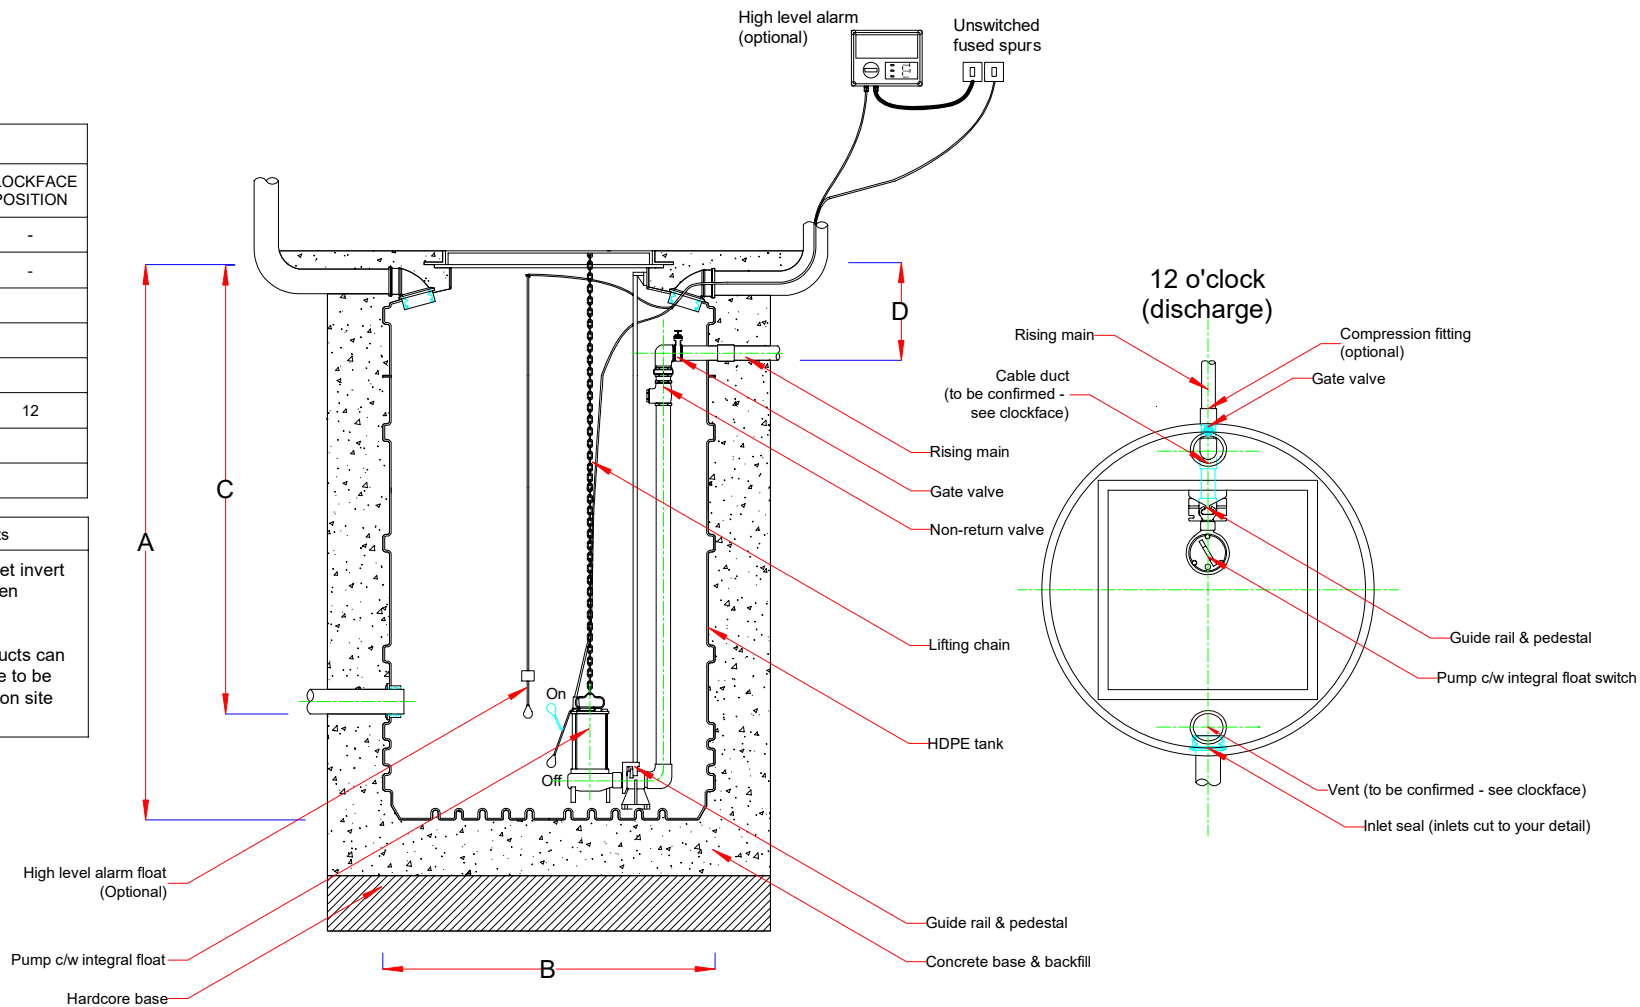

PLEASE NOTE THAT THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH THE INSTALLATION & OPERATING GUIDELINES

REV	DETAIL	DATE	DRAWN	TITLE
				Single rigged Ø1500 x 2500 mm typical layout
				CUSTOMER

DRAWING NO	DATE	DRAWN
DPT113029	12/02/2019	gf
THIRD ANGLE PROJECTION		SCALE
		NOT TO SCALE
		SHEET
		1 of 1
TOLERANCE +/- 2%		REV 0